


- NOTES:**
1. THE BOTTOM 12 INCHES OF THE FABRIC SHALL BE BURIED IN A 6 INCH TRENCH CUT INTO THE GROUND OR COVERED BY 6 INCHES OF FILL MATERIAL, TO PREVENT SEDIMENT ESCAPING UNDER THE FENCE. ALL EARTHWORK SHALL BE ON THE UPSTREAM SIDE OF THE FENCE.
 2. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES.
 3. FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID-SECTION.
 4. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

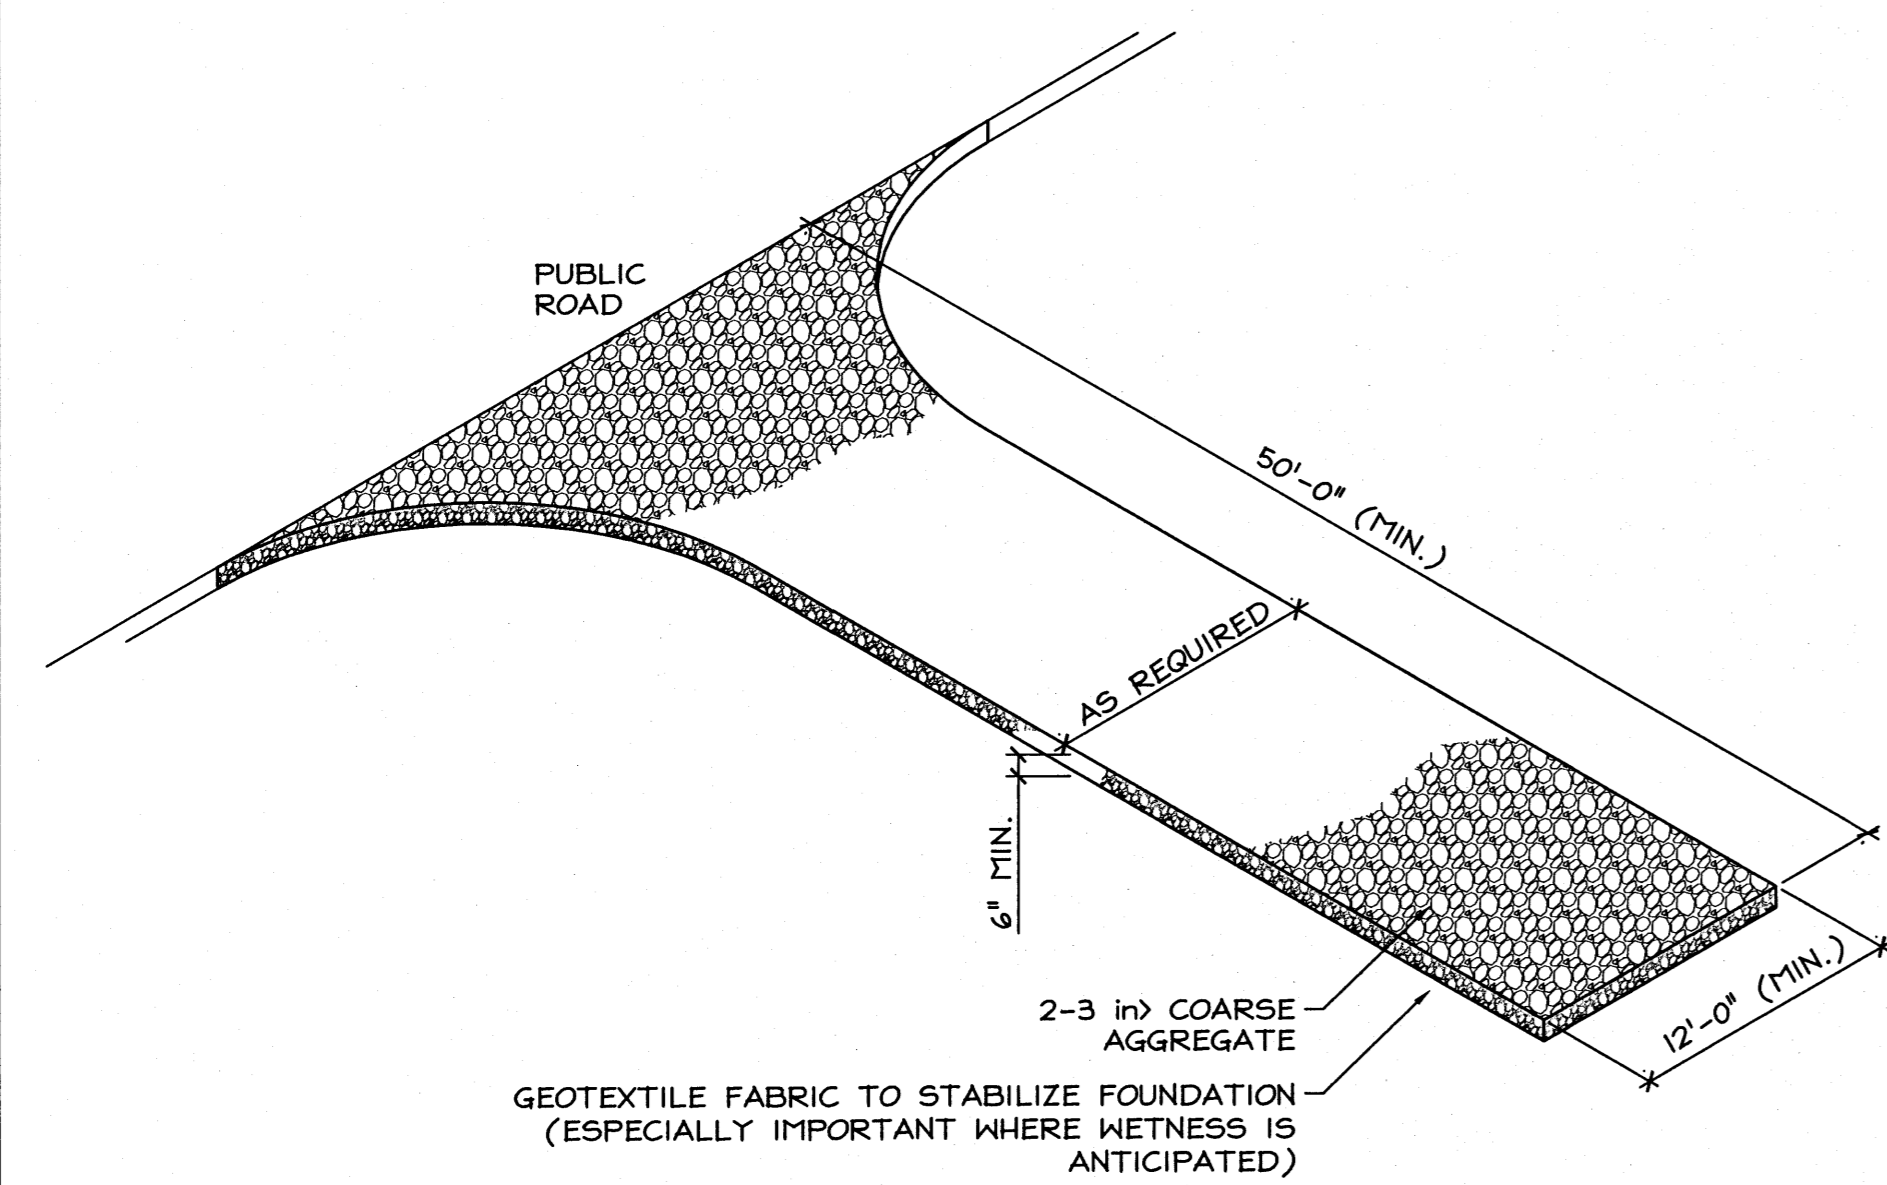




REQUIREMENTS:

- MATERIAL:** 2-3 in. WASHED STONE (INDOT CA No. 2) OVER STABLE FOUNDATION.
- THICKNESS:** 6" MINIMUM
- WIDTH:** 12'-0" MINIMUM OR FULL WIDTH OF ENTRANCE/EXIT ROADWAY, WHICHEVER IS GREATER.
- LENGTH:** 50'-0" MINIMUM. THE LENGTH CAN BE SHORTER FOR SMALL SITES SUCH AS FOR AN INDIVIDUAL HOME.
- WASHING FACILITY (OPTIONAL):** LEVEL AREA WITH 3 in. WASHED STONE MINIMUM OR COMMERCIAL RACK, AND WASTE WATER DIVERTED TO A SEDIMENT TRAP OR BASIN (PRACTICE 3.72).
- GEOTEXTILE FABRIC UNDERLINER:** MAY BE USED UNDER WET CONDITIONS OR FOR SOILS WITHIN A HIGH SEASONAL WATER TABLE TO PROVIDE A GREATER BEARING STRENGTH.

INSTALLATION:

1. AVOID LOCATING ON STEEP SLOPES OR AT CURVES IN PUBLIC ROADS.
2. REMOVE ALL VEGETATION AND OTHER OBJECTIONABLE MATERIAL FROM THE FOUNDATION AREA, AND GRADE AND CROWN FOR POSITIVE DRAINAGE.
3. IF SLOPE TOWARDS THE ROAD EXCEEDS 2%, CONSTRUCT A 6"-8" HIGH WATER BAR (RIDGE) WITH 3:1 SIDE SLOPES ACROSS THE FOUNDATION AREA ABOUT 15 FT. FROM THE ENTRANCE TO DIVERT RUNOFF AWAY FROM THE ROAD. (PRACTICE 3.24)
4. INSTALL PIPE UNDER THE PAD IF NEEDED TO MAINTAIN PROPER PUBLIC ROAD DRAINAGE.
5. IF WET CONDITIONS ARE ANTICIPATED, PLACE GEOTEXTILE FABRIC ON THE GRADED FOUNDATION TO IMPROVE STABILITY.
6. PLACE STONE TO DIMENSIONS AND GRADE SHOWN IN THE EROSION/SEDIMENT CONTROL PLAN, LEAVING THE SURFACE SMOOTH AND SLOPED FOR DRAINAGE.
7. DIVERT ALL SURFACE RUNOFF AND DRAINAGE FROM THE STONE PAD TO A SEDIMENT TRAP OR BASIN.

TEMPORARY GRAVEL ENTRANCE/EXIT PAD DETAIL (C204)

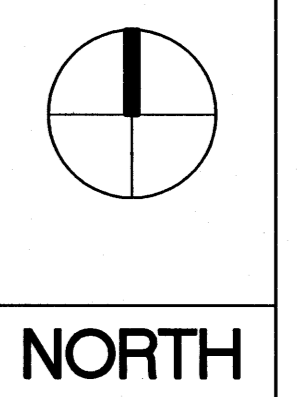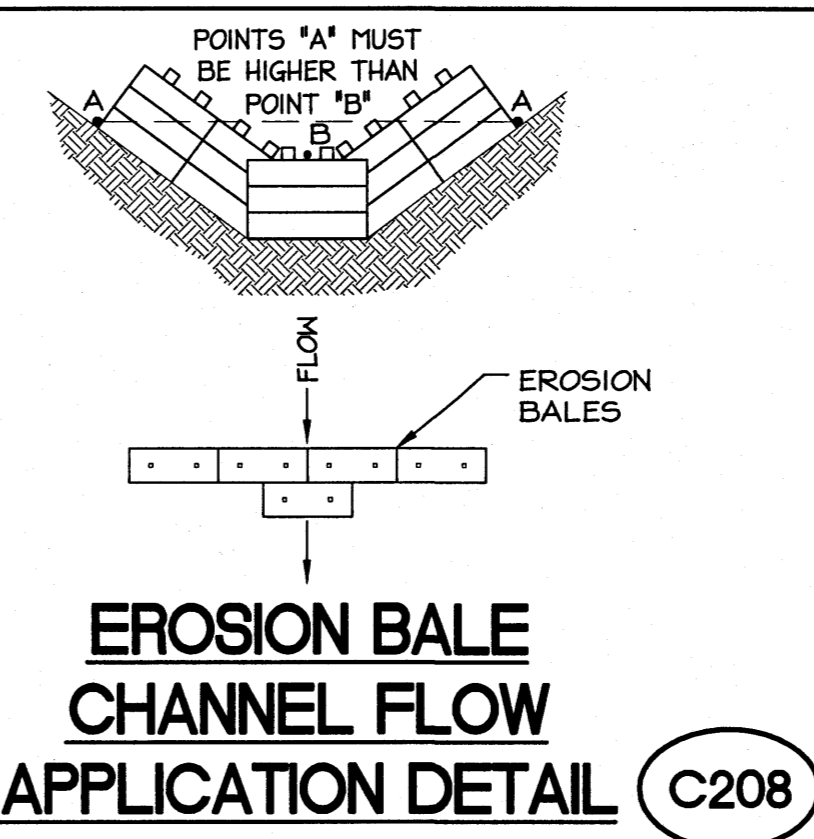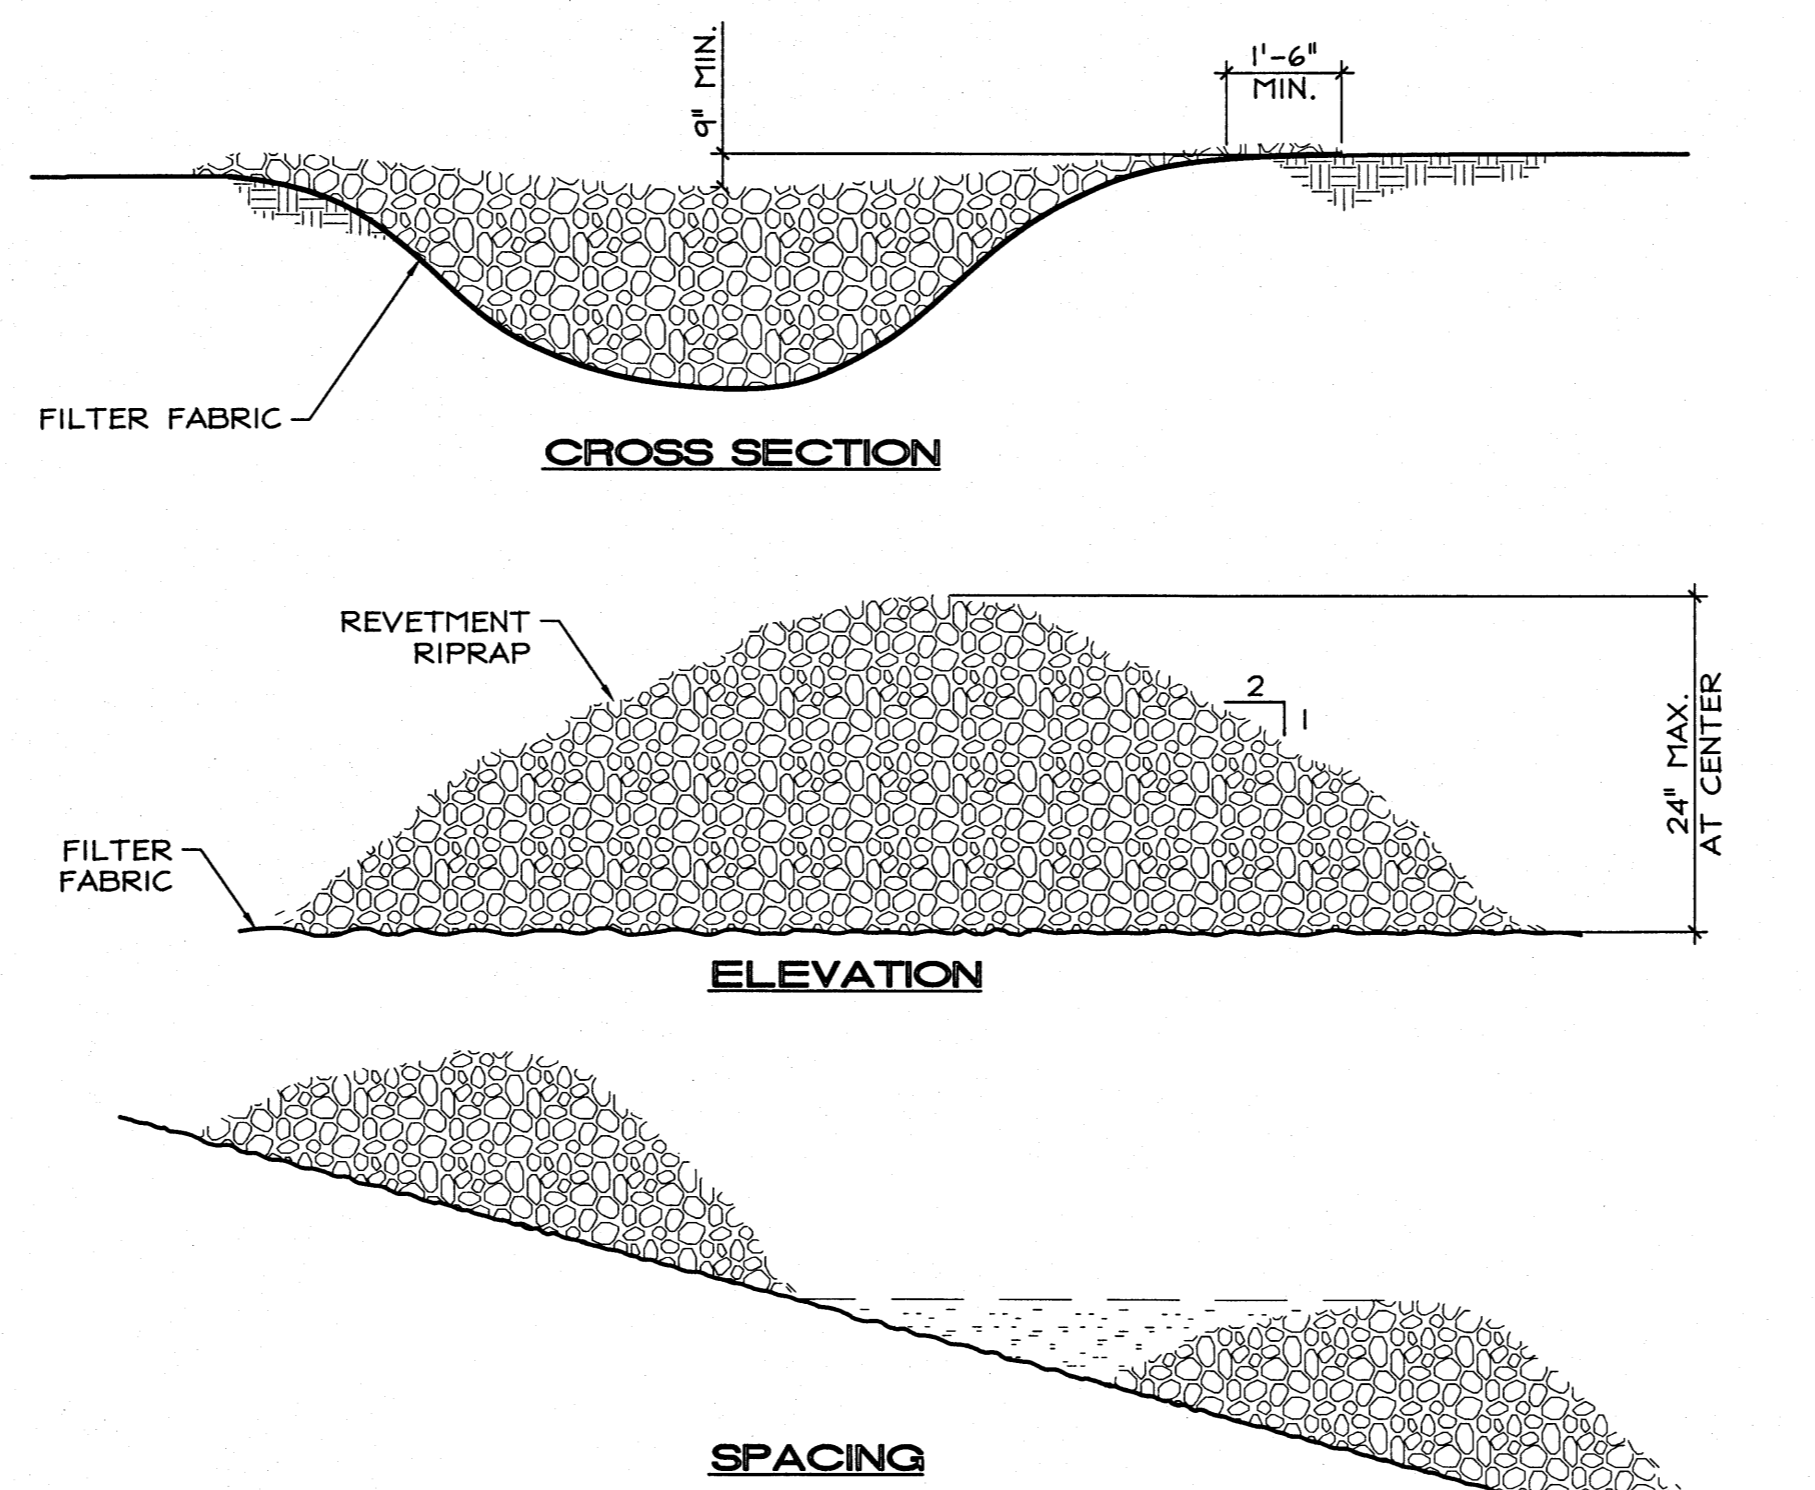

Professional Consultants, Inc.
 Evansville • Rockport
 Engineering/Architecture
 Construction Management
 www.pcdesign.com

ISSUE	DATE	DESCRIPTION

PROJECT NUMBER: _____
 DRAWN BY: APA DATE: 07/09/03
 DESIGNED BY: JWB DATE: 07/09/03
 TECH CHECKED BY: JWB DATE: _____
 QC CHECKED BY: _____ DATE: _____

EROSION CONTROL DETAILS

C-503
 SHEET NUMBER

FOR CONSTRUCTION